




Contents list available at IJRED website

Int. Journal of Renewable Energy Development (IJRED)

Journal homepage: <http://ejournal.undip.ac.id/index.php/ijred>



Research Article

Microgrids For Rural Schools: An Energy-Education Accord to Curb Societal Challenges for Sustainable Rural Developments

Abhi Chatterjee^{a*}, Alan Brent^{a,b}, Ramesh Rayudu^a and Piyush Verma^{a,c}

^a Sustainable Energy Systems, School of Engineering and Computer Science, Victoria University of Wellington, Wellington, 6140, New Zealand

^b Department of Industrial Engineering, and the Centre for Renewable and Sustainable Energy Studies, Stellenbosch University, 7600, South Africa

^c International Energy Research Centre (IERC), Tyndall National Institute, Cork, Ireland

ABSTRACT. Quality education and schools have a key role to play in the sustainable development of society. Unfortunately, many remote communities in developing countries fail to enjoy access to quality education due to a lack of electricity, thereby interrupting regular school services in the villages. The main objective of the paper contributes to understanding the importance of the energy-education accord, and aims to curb the social challenges prevailing in the villages. Specifically, the paper suggests a technical intervention by designing a hybrid renewable energy system for such schools. The approach is demonstrated through a case study with a load demand of approximately 4 kWh/d, comprising a class size of 40 students. A techno-economic evaluation of the energy system reveals the levelized cost of energy of the system at USD 0.22 per kWh, which may be affordable considering number of other aspects, outlined in this paper, to enable a larger uptake of such systems in developing countries. ©2019. CBIORÉ-IJRED. All rights reserved

Keywords: microgrids, rural electrification, rural school and education, techno-economic analysis, sustainable development goals

Article History: Received: May 1, 2019; Revised: August 26, 2019; Accepted: Sept 3rd 2019; Available online: Oct 30, 2019

How to Cite This Article: Chatterjee, A., Brent, A., Rayudu, R. and Verma, P. (2019). Microgrids for rural schools: An energy-education accord to curb societal challenges for sustainable rural developments. *International Journal of Renewable Energy Development*, 8(3), 231-241. <https://doi.org/10.14710/ijred.8.3.231-241>

1. Introduction

The United Nations Development Program (UNDP) aims for affordable and clean energy access (Aggarwal et al., 2014), and sustainable, decentralized systems have gained importance across the globe for the provision of access to electricity (Energy Information Administration, 2040; *IEA webstore. WEO-2017 Special Report: Energy Access Outlook*). Specifically, the decentralized systems have emerged as a leapfrogging approach over the decades for the provision of electricity to the remote locations of developing nations, where the access to centralized grid services are afflicted due to many challenges (Hiremath, Kumar, Balachandra, Ravindranath, & Raghunandan, 2009; van Gevelt et al., 2018). Moreover, other factors, governing a paradigm shift towards a renewed interest in decentralized systems, have been the result of improved and efficient performances of the power technology equipment paring with the appliance costs (Barman, Mahapatra, Palit, & Chaudhury, 2017; Bensch, Peters, & Sievert, 2017; Louie, 2016; Mentis et al., 2015; Rojas-Zerpa & Yusta, 2014). Also, higher installation and maintenance costs of the conventional transmission and distribution systems, with an inclination towards the

notion of ‘sustainable energy democracy’, have resulted in growing interests towards small-scale energy systems (Burke & Stephens, 2017; Mandelli, Barbieri, Mereu, & Colombo, 2016), especially for those deprived of basic electricity access (“WEO 2018).

Literature review

The scientific literature has addressed the issue with a focus on effective ways of energy source utilization techniques for small scale generations (Arto, Capellán-Pérez, Lago, Bueno, & Bermejo, 2016; Herington, van de Fliert, Smart, Greig, & Lant, 2017; Riva, Ahlborg, Hartvigsson, Pachauri, & Colombo, 2018). For instance, Rojas-Zerpa and Yusta examined the energy models, which can mathematically be utilized for rural electrification by introducing new paradigms for remote electricity evaluation criteria (Rojas-Zerpa & Yusta, 2014). Also, in the developing countries like India, Bangladesh and Malaysia, with a high prevalence of un-electrified villages (EIA, 2016; International Energy Agency (IEA), 2017), substantial efforts by the nodal renewable development agencies towards acquiring electricity for the rural despondent are evident (Palit and

* Corresponding author: abhi.chatterjee@ecs.vuw.ac.nz

Chaurey, 2011; Taseska-Gjorgievska *et al.*, 2013; Saebi and Seyyed Mahdavi, 2018). For instance, projects like DESI Power and Gram Oorja in India, EDH in Haiti, and GE/T/P in Malaysia have been the driving examples of implemented microgrid projects using solar energy as the power generating source for electrifying the households (Shiroudi *et al.*, 2012; Sandwell *et al.*, 2016; Saebi and Seyyed Mahdavi, 2018).

Several methods are reported in the literature to highlight the importance of using hybrid renewable energy systems over the use of single-source systems for off-grid or island electrification (Chatterjee, Brent, & Rayudu, 2018; Chatterjee & Rayudu, 2017). Furthermore, many techno-economic studies are reported, which consider efficient optimization techniques for hybrid renewable energy sources to be utilized for the households, street lights and community health centers in off-grid communities and islands (Bhakta, Mukherjee, & Shaw, 2015; Diab & Ali, 2016; Jahangiri, Nematollahi, Sedaghat, & Saghafian, 2015; Mirzaei & Vahidi, 2015; Mohamed, Eltamaly, & Alolah, 2015; Saebi & Seyyed Mahdavi, 2018; Tijani, Wei Tan, & Bashir, 2014). A recent study emphasizes the identification of the rural typology with a mandatory storage system to be incorporated for designing a renewable energy system for rural electrification (Chatterjee, Burmester, Brent, & Rayudu, 2018). The author identifies the need for amendments to the technical standard IEC/TS 62257-2 to reduce the system complexity, thereby enabling an increase in the microgrid deployments for energy challenged villages.

Although the UNDP recognizes SDG.4 “quality education” as one of the 17 global goals that make up the 2030 Agenda for Sustainable Development, progress in education access has lacked behind, with 103 million youth worldwide lacking the basic proficiency in reading and understanding numbers (Pradhan, Costa, Rybski, Lucht, & Kropp, 2017). In addition, one in every four girls in a developing country have never been enrolled in a school (Jha *et al.*, 2011; Li, Mattes, Stanley, McMurray, & Hertzman, 2009; Roy & Chattopadhyay, 2012). These situations are prominent in the remote locations of developing countries where a contrasting difference lies in the literacy rate of the urban and the rural dwellers (Chu, Wang, Xiao, & Zhang, 2017; Karakurum-Ozdemir, Kokkizil, & Uysal, 2018; Kararach *et al.*, 2018; Lee, Low, Chong, & Sia, 2018). With a lower literacy rate in the villages, a dominant population lacks basic knowledge of energy management, sanitation, health care and wellbeing, in addition to increased inequalities and gender discrimination in the society. With a lack of health care knowledge and well-being, the employability scope reduces, adding to the poor economy and failure towards an integrated approach towards eradication of poverty. Thus all aspects of the SDGs are interconnected.

The statistics reveal that, in a developing country like India, the majority of the youth is in rural populations without basic education (Datta Gupta, Dubey, & Simonsen, 2018). The Government of India has subsequently started special programs and schemes for imparting compulsory education, such as “*Sarva Shiksha Abhiyan*” meaning “education for all” (Mir, 2018; A. Sharma & Bairwa, 2018; Yadav, Sharma, & Birua, 2018), and “*Beti Bachao, Beti Padhao Yojana*” meaning “save girl

child and educate the girl child” (Saini & Sangwan, 2018; Verma, Dhaka, & Agrawal, 2018). Also, programs such as “midday meals” which is a complimentary program evolving with educational programs, aims at improving the nutritional standards of school children, can be seen as a step towards attracting the dwellers to schools and thereby progressing towards the achievement of the desired SDGs (Ayyub, 2018; Chakraborty & Jayaraman, 2019; T. Kumar, 2018; Power, Michalik, Couture-Nowak, Kent, & Mistlberger, 2018). Despite these efforts, the education in the rural villages of India has lagged behind, due to the lack of proper electrified primary schools, with prior research suggesting only 27 percent of village schools are electrified, compared to 76 percent of schools in urban regions (Ranjan, 2018). The lack of electricity infrastructure in the schools of remote communities often results in the students to use kerosene lanterns as an alternative (Aklin, Bayer, Harish, & Urpelainen, 2017; GNESD, 2014; Khandker, Barnes, & Samad, 2012; World Bank & Bank, 2008). Notwithstanding the ill-effects of the prolonged usage of kerosene lanterns, which lead to various lungs and respiratory issues, reduced eyed vision, and communicable diseases, such as tuberculosis, among the school students, the realization of the importance of electricity provision for education has been found to be scarce (Diniz, França, Câmara, Morais, & Vilhena, 2007).

The case of Lawjora

A primary school at Lawjora, in the provincial state of Jharkhand, India, is considered as a case study for the research. The selection of the school is based on the fact that the presented research is the first in the state of Jharkhand, and a similar approach can solve the issues pertaining to a lack of electricity access for rural schools in the nearby villages, and similar developing country contexts. Also, the school is an exemplary scenario where a contrast in electricity access exists between the energy access in rural and urban areas considering the school is in proximity of 26 kilometers to the city Jamshedpur. The city is renowned for an iron and steel company and various other industries, and is the largest and the most developed city in the province of Jharkhand, with adequate facilities for a decent standard of living. However, the village remains in a state of poverty, primarily because it is separated by a river with a lack of infrastructure (K. Sharma, 2019; Walia, 2018). The provision of basic education and promoting social awareness among the residents of the village through education was identified as a necessary solution to the enduring village issues (A. Kumar, 2008).

A school in the village was subsequently established through the central-state government initiative as a part of the compulsory education scheme of the Government of India. The objective of the school was to diagnose the social issues and positively influence the youth. The school targeted the locals of the village to send their children for primary education in the age group of 6 to 14 years, with class sizes of approximately 40 combined age group students. However, interactions with the village children, and a senior representative of the village council, revealed a failure in the proper functioning of the village primary school stating the fundamental reason as an

“inappropriate environment of the classrooms due to a lack of electricity access in the school”. The absence of the electricity infrastructure has led to a lower retention period and attendance of the government teachers in the school for its proper functionality. Also, the non-conductive environment of the school classrooms presently attracts the children to visit the school for the midday meal only, rather than an interest in education and well-being.

The nearby villages experiencing similar circumstances, thereby urging the need for a technical approach to overcome the persisting socio-economic challenges of the villages in the province. The main objective of the paper is to propose a methodology to address the electricity challenges in the schools by demonstrating a sustainable hybrid microgrid system design, based on a lower levelized cost of energy that conforms to the affordability and the reliability attributes of the energy system for a school in remote locations. Furthermore, the research highlights key recommendations for further considerations, to disseminate the nexus for an electricity-education accord thereby strengthening the efforts in achieving the UNDP targets by the year 2030.

2. Research Methodology

For demonstrating the research strategy for electrifying a rural-based educational institution, a hybrid renewable energy system constituting of solar and the wind energy with battery storage has been designed for the remote primary school in the province of Jharkhand, India. The selected village, Lawjora, located in the East-Singhbhum district of Patamda block in the state of Jharkhand, India, is at an altitude of 129 meters above sea level. Fig. 1 and Fig. 2 illustrates the solar and the wind profile for the selected location as obtained from the global National Renewable Energy Laboratory (NREL) website considering the best practices for resource collection for renewable energy applications (Sengupta et al., 2015). The selected village typically receives the best daily solar irradiation ($\text{kWh}/\text{m}^2/\text{d}$) in the month of April, followed by the lowest solar irradiation in the month of December. However, the average annual irradiance scaled for the location is $5 \text{ kWh}/\text{m}^2/\text{d}$, with a peak wind speed power of 15 hours and a scaled annual average wind speed of 2.6 m/s. The ample available renewable energy resources have thereby been considered for sustainable energy access for electricity to the school. The other corresponding factors, considered for effective utilization of wind turbines, constitute a Weibull distribution factor, a diurnal pattern strength and an auto-correction factor; of 2, 0.25 and 0.85 respectively.

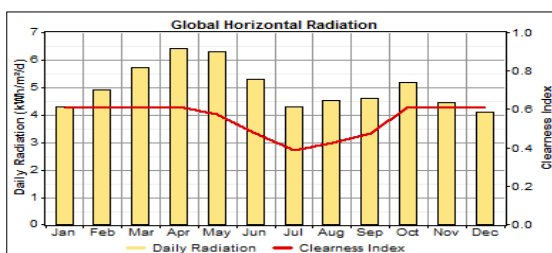


Fig. 1 The solar profile for the selected location

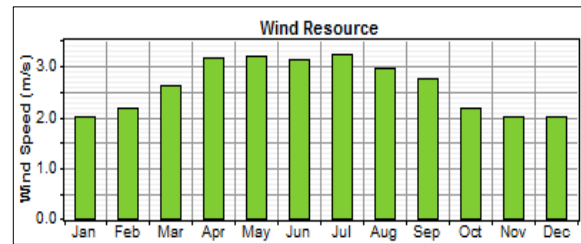


Fig. 2 The wind profile for the selected location

Load Profile Estimation

A load profile for the school was generated considering a systematic approach towards a similar usage of the electrical appliances over the year, with a varying seasonal load pattern demand and two seasons (summer and winter) have been considered for the site. The pivotal task of identifying the electrical appliances to be used by the school comprises of the compact fluorescent lamps (CFLs) for lighting, ceiling fans for cooling, a mobile charging unit, a desktop computer and television for promoting information and communications technology (ICT) activities in the school.

These appliance selections confirm the IEC/TS standard 62257, with Table 1 summarizing the electricity demand profile (EDP) for the primary school. A Hybrid Renewable Energy System (HRES) was then modelled for a primary school with a demand load of $4.3 \text{ kWh}/\text{d}$, a peak load of 1.1 kW , and a load factor of 0.16. The school had fixed working hours for its functionality, which was utilized to determine the number of appliances in a working state for every hour of a day generates a 24-hour load for two different seasons, as shown in shown in Fig. 3 and Fig. 4. For instance, the school starts at 8 am in the morning where the electric load constitutes the lighting and cooling load in the form of CFLs and ceiling fans during summer season. In addition to these, the desktop adds to the profile with variations in the mobile charging unit as when required. The school runs until 4 pm in the afternoon with an hour lunch from 12 pm to 1 pm. Also, the last hour of the school day constitutes an ICT session delivered via the desktop or television. The school runs until 4 pm in the afternoon with an hour lunch from 12 pm to 1 pm. Also, the last hour of the school day constitutes an ICT session delivered via the desktop or television. The administration work of the school is carried out till 5 pm hours, a lighting load is considered to be operating in the after-hours of the school as part of security measures to prevent theft and vandalism after which the school closes for the day. While the maximum electrical load is experienced during the school it is important to consider the absence of cooling load, in the form of ceiling fans in the winter season. With almost a definite electricity pattern usage, a random variability of 5 per cent with a time-step-to-time step variation of 10 per cent was considered for simulation of the microgrid system. An average annual load profile of the school is shown in Fig. 5. Based on the load profile generated, an HRES as shown in Fig. 6 was modelled, integrating a solar photovoltaic (PV) panel with a wind turbine as the main power generation units. A battery based storage system with the purpose of maintaining a quality power and reliability was considered in the model along with a converter.

Table 1
Electricity Demand Profile of the Primary School

Electrical Load	Units of Appliances	Watts	Summer Season		Winter Season	
			Hrs/d	Watt-Hrs/d	Hrs/d	Watt-Hrs/d
CFL	10	20	9	1800	9	1800
Ceiling Fan	5	60	9	2700	NIL	NIL
Desktop	1	300	9	2700	9	2700
Mobile Charger	1	5	3	15	3	15
Television	1	60	1	60	1	60
Total				7275		4575

3. Parametric Selections for the system design

The derating factor that accounts for the reduction in PV output over the timespan of usage for the selected village was set as 90 per cent, with a ground reflectance of 20 per cent, and a slope angle of 22.8 degrees. Also, the temperature coefficients of power in per cent per degree centigrade ($\%^{\circ}\text{C}$) of -0.5 , a nominal operating cell temperature of 47°C , and an efficiency of 13 per cent at standard test conditions were assumed. For an economic evaluation, the value of per kW capital cost of the PV module and replacement cost was USD \$1330, for the project lifetime of 25 years.

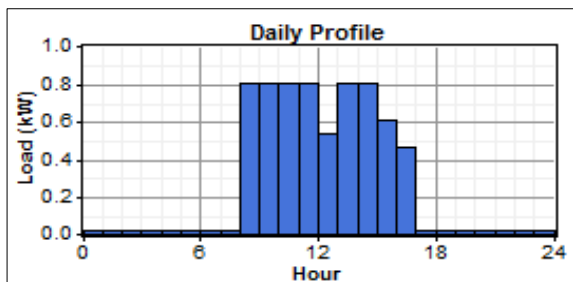


Fig. 3 Load profile of the primary school on a 24-hour timeline basis for summer season

A 3-blade upwind turbine with a rated output power of 2.5 kW was considered at a hub height of 24m. The capital cost of a wind turbine has been assumed to be USD \$1500, with a replacement cost of USD \$1000.

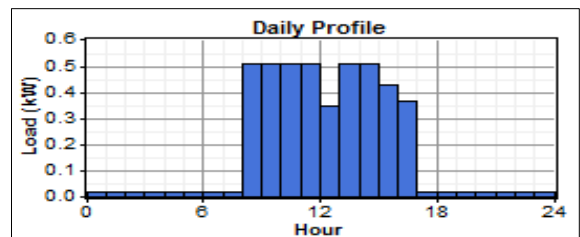


Fig. 4 Load profile of the primary school on a 24-hour timeline basis for winter season

A Trojan L16P deep-cycle battery was considered with a nominal capacity and voltage of 2.34 (kWh) and 6 V respectively and a maximum capacity of 390 (Ah). The capacity ratio of the storage unit is 0.267 with a rate constant (1/hr) of 1.65. Also, the round-trip efficiency, which determines the fraction of the energy that can be restored, is 85 per cent. It was assumed that the properties of the storage system are unaffected by external factors such as temperature. However, the operation of the battery was set so that the state of charge (SoC) level would never to be drawn below 30 per cent. The capital cost and replacement cost of the battery at approximately every ten years were determined as USD \$170 and USD \$130 respectively.

As most solid-state converters are less efficient at low load due to standing losses, a converter has been introduced in the HRES model. The capital cost per kW and the replacement cost at the end of the fifteenth year was USD \$300 and USD \$300, for the project.

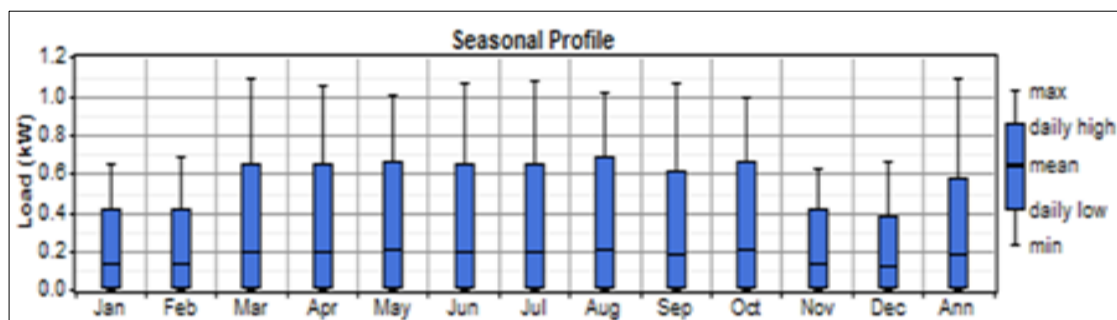


Fig. 5 The seasonal and annual load profile of the school

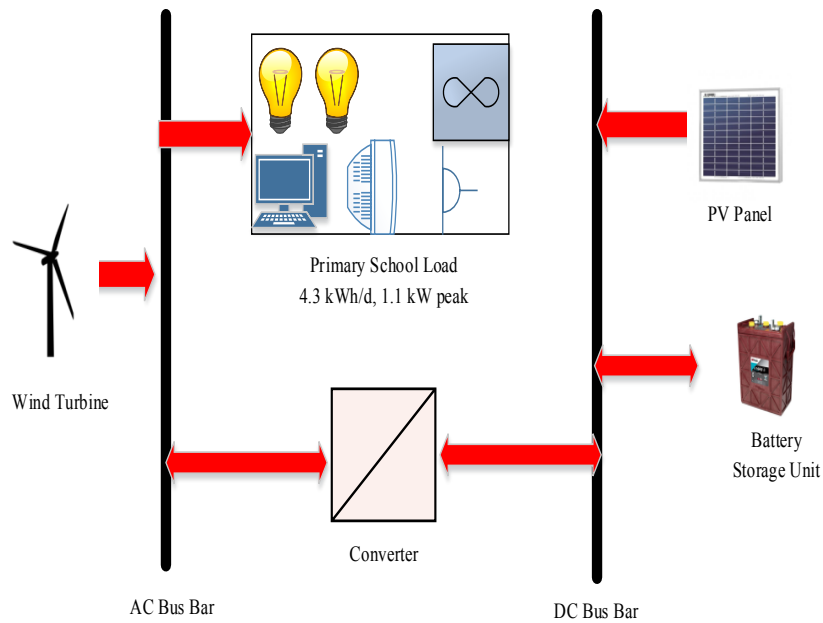


Fig. 6 Architecture and model of HRES for rural primary school

4. Results and Discussion

The analysis of the modelled HRES can be broadly classified into two phases, namely a technical and an economic assessment. The technical aspects discussed in this paper is based on the technical specifications as per the IEC/TS 62257 standards for rural electrification

(Louie, 2018). The technical standards specify recommendations and microgrid system designs for hybrid systems with respect to rural electrifications. The economic aspects of the case study discuss the cost analysis of an annualized and net present cost of the system on the basis of the system components and resources selected.

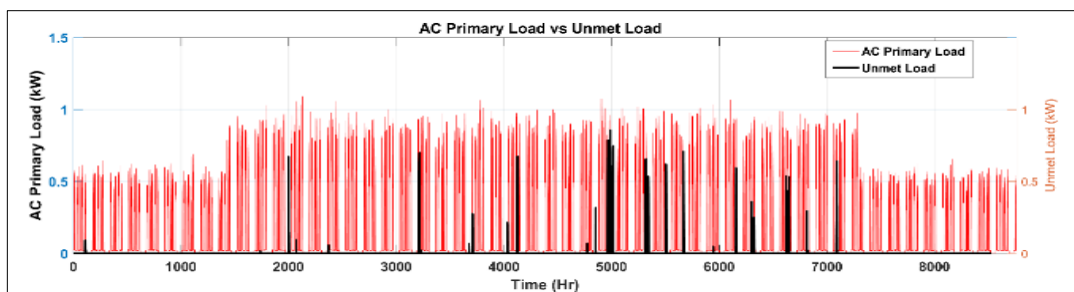


Fig. 7 Analysis of comparison of AC Primary load and unmet load

Technical Analysis

The technical analysis of the system is based on the energy management layout as specified in the IEC/TS 62257 standard for rural locations and communities, where the balancing of the load as per the user's requirements are given priority. In order to achieve the goal of energy management for balancing the electrical load of the school, as stated before, the HRES was modelled for an average of 4.3 kWh/day with a peak load demand of 1.1 kW. The model has been configured to support the necessary energy requirement.

The reliability of a system based on a 100 per cent renewable fraction (RF), is an important aspect of any microgrid system, considering the intermittent nature of the renewable energy sources. It, therefore, necessitates

the purpose to analyze the system for the AC primary load consumption, which is 1519 kWh/yr with an unmet load of 2.5 percent kWh/yr, as seen in Fig. 7 for the energy system designed for the school. The preceding technical analysis of the microgrid is followed by the capacity utilization of the resources for the off-grid system as per IEC/TS 62257. The share of average electricity production of the system constitutes 59 per cent PV power and 41 per cent wind energy power, as shown in Fig. 8. Also, Fig. 8 answers the need for considering an HRES system for an off-grid location considering the system reliability aspects wherein the present case a deficit of solar energy in winters was seen to be nullified by the presence of an additional wind energy source. The modelling and parametric selection thereby indicate that the selected HRES is suitable for the

geographical conditions of the selected rural site for the microgrid installation. Consecutively, the simulation results reveal the hours of operation of the PV module and the wind turbine as 4365 hr/yr and 5521 hr/yr respectively.

The technical investigation is further followed by the analysis of the electrical properties of the battery storage unit. The system has been modelled with a battery string size of 4 and a bus voltage of 24 V. The nominal capacity of the battery is 8.6 kWh with a usable nominal capacity

of 6 kWh. The lifetime throughput of the battery, defined as the yearly cycling of the energy, is 4300 kWh with an annual throughput of 426 kWh/yr. However, the system losses for the battery unit accounts for 67 kWh/yr with the SoC of the battery unit has been set not to draw below 30 percent of the maximum battery storage limit. This accounts for a healthy state of the battery storage unit for a major portion of the year, accounting for 90 per cent per year with the SoC level reaching the set criteria for less than 5 per cent for an entire year, as seen in Fig. 9.

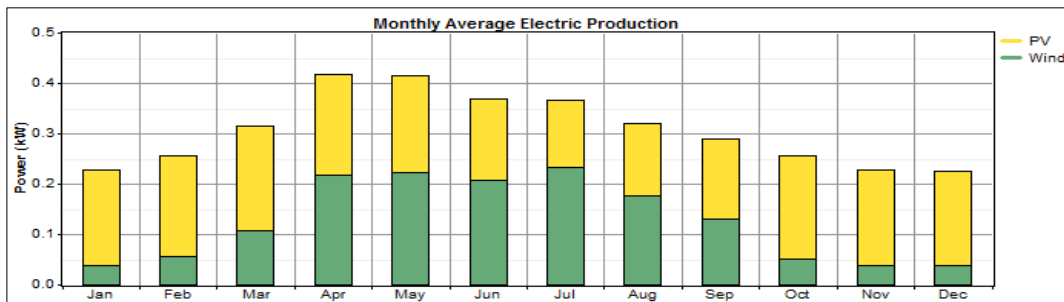


Fig. 8 Monthly average electrical production from the PV/wind generation sources

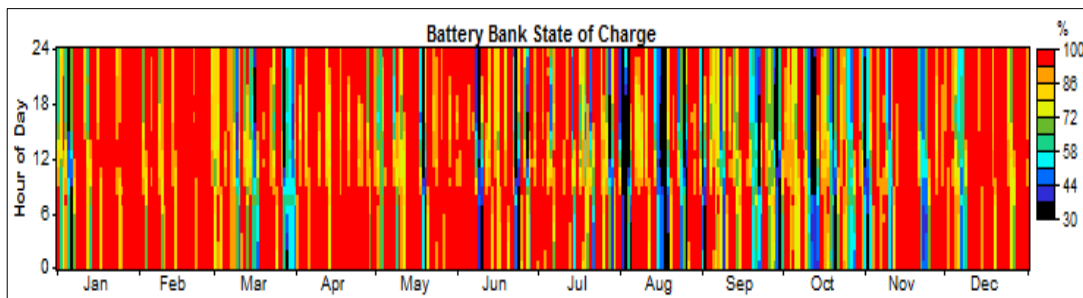


Fig. 9 D-Map of the SoC of the battery storage system

Economic Analysis

The importance of economic analysis lies in understanding the aspects of the economic feasibility of the microgrid infrastructure, enabling it to be implemented on a practical level. Also, it could be a step forward to attract investors, utilities and the nodal agencies for setting up an off-grid electrification infrastructure where the centralized grid extension fails. The economics of any microgrid system is determined by the system’s overall net present cost (NPC), which is determined by the difference of the present existing value of all the costs incurred over lifetime, and the value of the salvage revenue earned over the project lifetime of 25 years, or cost of energy (COE), given by average cost per kWh of useful electricity generated by the system and the operating cost (OC), which is the summation of the operation and maintenance cost, fuel cost and replacement costs minus the salvage cost. In the present analysis the NPC, COE, and OC are USD \$4304, USD \$0.22 and USD \$39 respectively for an initial capital cost of USD \$3810.

The cost incurred for the system can be summarized on aspects of net present cost of the components for the project lifetime, as seen in Fig. 10, and the share of the net present cost of the parameters selected for the model,

based on cost type (capital cost, replacement cost, operating cost, and salvage value), as can be seen in Fig. 11. It can be seen that the PV and the wind turbine selected for the model require a capital investment of USD \$1330 and USD \$1500. The selected battery storage system and the converter used for the purpose of the system modelling show an impact on the overall economics of the project lifetime, with replacement costs in addition to the capital investments. The profit if any for the system adheres to the salvage value of the system components calculated at the end of the project lifetime.

Another aspect of analyzing the system is based on the annualized based cost summary of the HRES. An annualized based cost summary depicts a yearly based cost estimation for the economics of the system parameters involved in the project. This enables a relatively simple understanding of the economic analytics of the project involved.

An annual cost summary of the system parameters featuring the microgrid can be seen in Fig. 12, with the type of cash flow involved annually (capital cost, replacement cost, operating cost, fuel cost, and salvage value) for the system illustrated in Fig. 13.

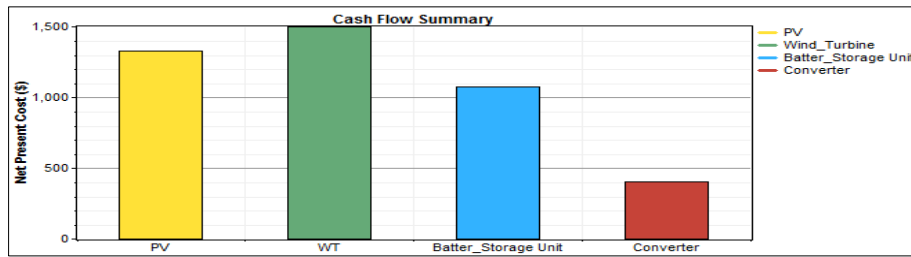


Fig. 10 Net Present Cost of the system by component type

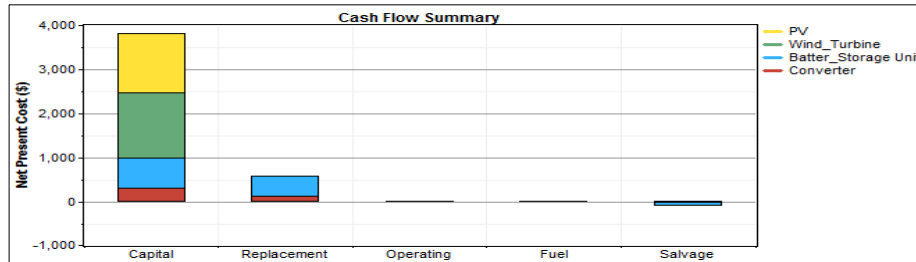


Fig. 11 Net Present Cost of a system based on cost type

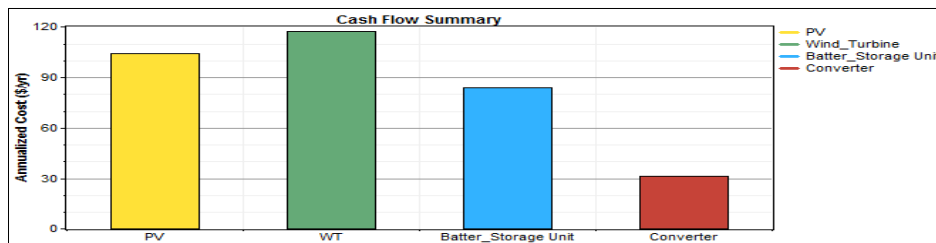


Fig. 12 The annualized cost of the system based on component cost

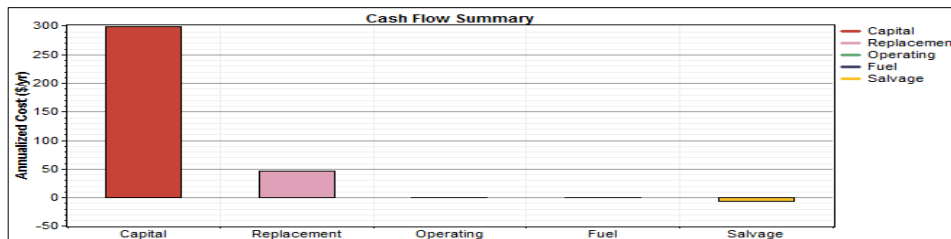


Fig. 13 Annualized summary of the system based on cost type

5. Aspects for further consideration to enable such systems

The previous section of the research focused on designing a sustainable microgrid system and evaluating the techno-economic feasibility thereof for an educational institution in a rural setting. However, in order to achieve an uninterrupted electricity service and boost the deployments of microgrids for the proper functioning of rural schools, the following needs to be considered:

- *Encourage private sector investment:* The issues pertaining to the lack of finances and a high CAPEX of the microgrids create challenges, which require private sector investments for developing rural education infrastructures. Strategies may include yearly tax exemptions for private organizations involved in addressing the energy-education nexus, tax incentives on

microgrid equipment, and other innovative business/subsidy models.

- *Participation of different Ministries and other government departments:* An alliance of various ministries of the government bodies for any country can be vital for improving the value proposition of microgrids in rural schools and accelerate its further deployments.
- *Awareness of energy consumption and management:* Awareness among the students and the teachers of the primary schools in terms of energy consumption patterns and the need for a paradigm shift to sustainable energy alternatives, can support towards improving the lives of the children in a long run.
- *Policies for energy efficient schemes:* India’s LED bulb program, ‘The UJALA Programme’, has become a world-class success story by providing

subsidized energy efficient bulbs to the economically challenged households in the rural areas (Nahar, Hasib, George, & Mukherjee, 2018). To achieve intensive electrification for the rural primary education institutions, a competitive business model like the 'UJALA Scheme' needs to be developed.

- *Establish an audit scheme for microgrids supporting rural primary schools:* An average annual load growth due to an increase in class size and a number of appliances, requires a

regular assessment on a 5-year interval basis, to evaluate the quality indicators for reliable and uninterrupted electricity supply to the schools. Further, a 5-year audit scheme would also determine the cash flow analysis, thereby recognizing the specific areas of improvisation for the system's overall finances and decisions. Table 2 demonstrates a sample of a 5-year audit scheme for the primary village school considered for the case study in the research

Table 2
Tabulation of a 5-year cash flow assessment of the microgrid for the rural school

Component	Cost Category	Cash Flow every 5 Year					Total Cost	
		0	5	10	15	20		25
PV	Capital	-1,330	0	0	0	0	0	-1,330
	Replacement	0	0	0	0	0	0	0
	Salvage	0	0	0	0	0	0	0
	Operating	0	0	0	0	0	0	0
	Total	-1,330	0	0	0	0	0	-1,330
Wind-Turbine	Capital	-1,500	0	0	0	0	0	-1,500
	Replacement	0	0	0	0	0	0	0
	Salvage	0	0	0	0	0	0	0
	Operating	0	0	0	0	0	0	0
	Total	-1,500	0	0	0	0	0	-1,500
Battery Storage Unit	Capital	-680	0	0	0	0	0	-680
	Replacement	0	0	-520	0	-520	0	-1,040
	Salvage	0	0	0	0	0	260	260
	Operating	0	0	0	0	0	0	0
	Total	-680	0	-520	0	-520	260	-1,460
Converter	Capital	-300	0	0	0	0	0	-300
	Replacement	0	0	0	-300	0	0	-300
	Salvage	0	0	0	0	0	100	100
	Operating	0	0	0	0	0	0	0
	Total	-300	0	0	-300	0	100	-500
Overall System	Capital	-3,810	0	0	0	0	0	-3,810
	Replacement	0	0	-520	-300	-520	0	-1,340
	Salvage	0	0	0	0	0	360	360
	Operating	0	0	0	0	0	0	0
	Total	-3,810	0	-520	-300	-520	360	-4,790

6. Conclusion

The research highlights the accord for the electricity-education at rural educational institutions as a fundamental task for the achievement of the SDGs. The paper uses a technical approach to address the social issues of similar characteristics underlying in the remote villages of developing countries where centralized grid extension is unlikely for the provision of electricity to schools. The research successfully demonstrates a

minimum energy requirement of 4.3 kWh/day for a rural primary education facility to balance the load requirement in the form of basic lighting, cooling, and other ICT devices. The economic analysis of the system model for a 25-year project lifetime indicates the net present cost and cost of energy as USD \$ 4304 and USD \$0.22/kWh respectively.

With the present scenario of the absence of encouraging microgrid policies in developing countries

like India, the study of the load estimation for the school in terms of technical aspects, followed by a 5-year cash flow economic assessment, and other considerations, are outlined for the successful deployment of microgrids; as a potential means to address the SDGs.

Acknowledgment

The author would like to acknowledge Victoria University of Wellington for the extensive support for this work through the VUW Research Trust. The authors acknowledge Associate Professor MJ (Thinus) Booyens from the Stellenbosch University, South Africa, for his availability to discuss the structure of the research and the issues pertaining to the remote electrification for educational institutions in the African context. Also, the authors would like to acknowledge the senior representatives and the residents of the village Lawjora, Patamda for sharing their valuable experiences and interests.

References

- Aggarwal, V., Fahey, A., Freymiller, H. S., Huang, C. C., Li, S., Moilanen, S., ... Scheetz Freymiller, H. (2014). *Rural Energy Alternatives in India: Opportunities in Financing and Community Engagement for Renewable Energy Microgrid Projects The villagers of Darewadi and their microgrid*. Retrieved from http://www.princeton.edu/sites/default/files/content/591f_Rural_Energy_Alternatives_in_India.pdf
- Aklin, M., Bayer, P., Harish, S. P., & Urpelainen, J. (2017). Does basic energy access generate socioeconomic benefits? A field experiment with off-grid solar power in India. *Science Advances*, 3(5), e1602153. <https://doi.org/10.1126/sciadv.1602153>
- Arto, I., Capellán-Pérez, I., Lago, R., Bueno, G., & Bermejo, R. (2016). The energy requirements of a developed world. *Energy for Sustainable Development*, 33, 1–13. <https://doi.org/10.1016/J.ESD.2016.04.001>
- Ayyub, A. (2018). The Effect of Midday Meal (MDMS) on Nutrition, Registration and Primary School Students in Madhya Pradesh: Case Study. *Journal of Management Science, Operations & Strategies (e ISSN 2456-9305)*, 1(3), 45–50. Retrieved from <http://management.nrjp.co.in/index.php/JMSOS/article/view/140>
- Barman, M., Mahapatra, S., Palit, D., & Chaudhury, M. K. (2017). Performance and impact evaluation of solar home lighting systems on the rural livelihood in Assam, India. *Energy for Sustainable Development*, 38, 10–20. <https://doi.org/10.1016/J.ESD.2017.02.004>
- Bensch, G., Peters, J., & Sievert, M. (2017). The lighting transition in rural Africa — From kerosene to battery-powered LED and the emerging disposal problem. *Energy for Sustainable Development*, 39, 13–20. <https://doi.org/10.1016/J.ESD.2017.03.004>
- Bhakta, S., Mukherjee, V., & Shaw, B. (2015). Techno-economic analysis of standalone photovoltaic/wind hybrid system for application in isolated hamlets of North-East India. *Journal of Renewable and Sustainable Energy*, 7(2), 023126. <https://doi.org/10.1063/1.4918792>
- Burke, M. J., & Stephens, J. C. (2017). Energy democracy: Goals and policy instruments for sociotechnical transitions. *Energy Research and Social Science*, 33, 35–48. <https://doi.org/10.1016/j.erss.2017.09.024>
- Chakraborty, T., & Jayaraman, R. (2019). School feeding and learning achievement: Evidence from India's midday meal program. *Journal of Development Economics*. <https://doi.org/10.1016/J.JDEVECO.2018.10.011>
- Chatterjee, A., Brent, A., & Rayudu, R. (2018). Distributed Generation for Electrification of Rural Primary School and Health Centre: An Indian Perspective. In *2018 IEEE Innovative Smart Grid Technologies - Asia (ISGT Asia)* (pp. 162–166). IEEE. <https://doi.org/10.1109/ISGT-Asia.2018.8467764>
- Chatterjee, A., Burmester, D., Brent, A., & Rayudu, R. (2018). Defining a remote village typology to improve the technical standard for off-grid electrification system design.(in press)
- Chatterjee, A., & Rayudu, R. (2017). Techno-economic analysis of hybrid renewable energy system for rural electrification in India. In *2017 IEEE Innovative Smart Grid Technologies - Asia (ISGT-Asia)* (pp. 1–5). IEEE. <https://doi.org/10.1109/ISGT-Asia.2017.8378470>
- Chu, Z., Wang, Z., Xiao, J. J., & Zhang, W. (2017). Financial Literacy, Portfolio Choice and Financial Well-Being. *Social Indicators Research*, 132(2), 799–820. <https://doi.org/10.1007/s11205-016-1309-2>
- Datta Gupta, N., Dubey, A., & Simonsen, M. (2018). Rising school attendance in rural India: an evaluation of the effects of major educational reforms. *Education Economics*, 26(2), 109–128. <https://doi.org/10.1080/09645292.2017.1387887>
- Diab, F., & Ali, S. (2016). An economic and environment friendly solution for the rural households' energy crisis in Egypt. *Journal of Renewable and Sustainable Energy*, 8(4), 045904. <https://doi.org/10.1063/1.4955112>
- Diniz, A. S. A. C., França, E. D., Câmara, C. F., Morais, P. M. R., & Vilhena, L. (2007). The important contribution of photovoltaics in a rural school electrification program. *Conference Record of the 2006 IEEE 4th World Conference on Photovoltaic Energy Conversion, WCPEC-4, 2*, 2528–2531. <https://doi.org/10.1109/WCPEC.2006.279760>
- EIA. (2016). *International Energy Outlook 2016. International Energy Outlook 2016* (Vol. 0484(2016)). [https://doi.org/www.eia.gov/forecasts/ieo/pdf/0484\(2016\).pdf](https://doi.org/www.eia.gov/forecasts/ieo/pdf/0484(2016).pdf)
- Energy Information Administration, U. (2016). *International Energy Outlook 2016*. Retrieved from www.eia.gov
- GNESD. (2014). *Renewable energy-based rural electrification: The mini-grid experience from India*.
- Herington, M. J., van de Fliert, E., Smart, S., Greig, C., & Lant, P. A. (2017). Rural energy planning remains out-of-step with contemporary paradigms of energy access and development. *Renewable and Sustainable Energy Reviews*, 67, 1412–1419. <https://doi.org/10.1016/J.RSER.2016.09.103>
- Hiremath, R. B., Kumar, B., Balachandra, P., Ravindranath, N. H., & Raghunandan, B. N. (2009). Decentralised renewable energy: Scope, relevance and applications in the Indian context. *Energy for Sustainable Development*, 13(1), 4–10. <https://doi.org/10.1016/J.ESD.2008.12.001>
- IEA webstore. *WEO-2017 Special Report: Energy Access Outlook*. (n.d.). Retrieved from <https://webstore.iea.org/weo-2017-special-report-energy-access-outlook>
- International Energy Agency (IEA). (2017). *Energy Access Outlook 2017*.
- Jahangiri, M., Nematollahi, O., Sedaghat, A., & Saghafian, M. (2015). Techno-economical assessment of renewable energies integrated with fuel cell for off grid electrification: A case study for developing countries. *Journal of Renewable and Sustainable Energy*, 7(2), 023123. <https://doi.org/10.1063/1.4918592>
- Jha, P., Kesler, M. A., Kumar, R., Ram, F., Ram, U., Aleksandrowicz, L., ... Banthia, J. K. (2011). Trends in selective abortions of girls in India: analysis of nationally representative birth histories from 1990 to 2005 and census data from 1991 to 2011. *The Lancet*, 377(9781), 1921–1928. [https://doi.org/10.1016/S0140-6736\(11\)60649-1](https://doi.org/10.1016/S0140-6736(11)60649-1)

- Karakurum-Ozdemir, K., Kokkizil, M., & Uysal, G. (2018). Financial Literacy in Developing Countries. *Social Indicators Research*, 1–29. <https://doi.org/10.1007/s11205-018-1952-x>
- Kararach, G., Nhamo, G., Mubila, M., Nhamo, S., Nhemachena, C., & Babu, S. (2018). Reflections on the Green Growth Index for developing countries: A focus of selected African countries. *Development Policy Review*, 36, 0432–0454. <https://doi.org/10.1111/dpr.12265>
- Khandker, S. R., Barnes, D. F., & Samad, H. A. (2012). The Welfare Impacts of Rural Electrification in Bangladesh. *Source: The Energy Journal The Energy Journal*, 33(1), 187–206. Retrieved from <http://www.jstor.org/stable/41323350>
- Kumar, A. (2008). *Education of tribal children in jharkhand: a situational analysis. Jharkhand Journal of Development and Management Studies XISS* (Vol. 6). Retrieved from <http://ssrn.com/abstract=1369125>
- Kumar, T. (2018). An Evaluation of Mid-Day Meal Scheme in Chatra District of Jharkhand. *SSRN Electronic Journal*. <https://doi.org/10.2139/ssrn.3245873>
- Lee, H.-S., Low, K.-L.-T., Chong, S.-C., & Sia, B.-K. (2018). Influence of Secondary and Tertiary Literacy on Life Insurance Consumption: Case of Selected ASEAN Countries. *The Geneva Papers on Risk and Insurance - Issues and Practice*, 43(1), 1–15. <https://doi.org/10.1057/s41288-017-0050-7>
- Li, J., Mattes, E., Stanley, F., McMurray, A., & Hertzman, C. (2009). Social determinants of child health and well-being. *Health Sociology Review*, 18(1), 3–11. <https://doi.org/10.5172/hesr.18.1.3>
- Louie, H. (2016). Operational analysis of hybrid solar/wind microgrids using measured data. *Energy for Sustainable Development*, 31, 108–117. <https://doi.org/10.1016/J.ESD.2016.01.003>
- Louie, H. (2018). Other Considerations. In *Off-Grid Electrical Systems in Developing Countries* (pp. 461–467). Cham: Springer International Publishing. https://doi.org/10.1007/978-3-319-91890-7_14
- Mandelli, S., Barbieri, J., Mereu, R., & Colombo, E. (2016). Off-grid systems for rural electrification in developing countries: Definitions, classification and a comprehensive literature review. *Renewable and Sustainable Energy Reviews*, 58, 1621–1646. <https://doi.org/10.1016/J.ESD.2015.12.338>
- Mentis, D., Welsch, M., Fuso Nerini, F., Broad, O., Howells, M., Bazilian, M., & Rogner, H. (2015). A GIS-based approach for electrification planning—A case study on Nigeria. *Energy for Sustainable Development*, 29, 142–150. <https://doi.org/10.1016/J.ESD.2015.09.007>
- Mir, M. H. (2018). *Research Journal of Humanities and Social Sciences*. *Research Journal of Humanities and Social Sciences* (Vol. 9). Athena Information Solutions Pvt. Ltd. Retrieved from <http://www.indianjournals.com/ijor.aspx?target=ijor:rjhss&volume=9&issue=4&article=018>
- Mirzaei, M., & Vahidi, B. (2015). Feasibility analysis and optimal planning of renewable energy systems for industrial loads of a dairy factory in Tehran, Iran. *Journal of Renewable and Sustainable Energy*, 7(6), 063114. <https://doi.org/10.1063/1.4936591>
- Mohamed, M. A., Eltamaly, A. M., & Alolah, A. I. (2015). Sizing and techno-economic analysis of stand-alone hybrid photovoltaic/wind/diesel/battery power generation systems. *Journal of Renewable and Sustainable Energy*, 7(6), 063128. <https://doi.org/10.1063/1.4938154>
- Nahar, A., Hasib, A., George, G., & Mukherjee, M. (2018). Energy Efficiency Measures Across Key Sectors in India—An Approach Towards Climate Change (pp. 29–34). Springer, Singapore. https://doi.org/10.1007/978-981-10-7122-5_4
- Palit, D., & Chaurey, A. (2011). Off-grid rural electrification experiences from South Asia: Status and best practices. *Energy for Sustainable Development*, 15(3), 266–276. <https://doi.org/10.1016/J.ESD.2011.07.004>
- Power, S. C., Michalik, M. J., Couture-Nowak, S., Kent, B. A., & Mistlberger, R. E. (2018). Midday meals do not impair mouse memory. *Scientific Reports*, 8(1), 17013. <https://doi.org/10.1038/s41598-018-35427-y>
- Pradhan, P., Costa, L., Rybski, D., Lucht, W., & Kropp, J. P. (2017). Earth's Future A Systematic Study of Sustainable Development Goal (SDG) Interactions. <https://doi.org/10.1002/2017EF000632>
- Ranjan, A. (2018). *Adult and extension education for rural people: a life long learning more than formal education*. Retrieved from <http://censusindia.gov.in/>
- Renewable energy-based rural electrification: the mini-grid experience from India - India Environment Portal | News, reports, documents, blogs, data, analysis on environment & development | India, South Asia. (n.d.). Retrieved February 1, 2019, from <http://www.indiaenvironmentportal.org.in/content/400813/renewable-energy-based-rural-electrification-the-mini-grid-experience-from-india/>
- Riva, F., Ahlborg, H., Hartvigsson, E., Pachauri, S., & Colombo, E. (2018). Electricity access and rural development: Review of complex socio-economic dynamics and causal diagrams for more appropriate energy modelling. *Energy for Sustainable Development*, 43, 203–223. <https://doi.org/10.1016/J.ESD.2018.02.003>
- Rojas-Zerpa, J. C., & Yusta, J. M. (2014). Methodologies, technologies and applications for electric supply planning in rural remote areas. *Energy for Sustainable Development*, 20, 66–76. <https://doi.org/10.1016/J.ESD.2014.03.003>
- Roy, T. K., & Chattopadhyay, A. (2012). Daughter discrimination and future sex ratio at birth in india. *Asian Population Studies*, 8(3), 281–299. <https://doi.org/10.1080/17441730.2012.714669>
- Saebi, J., & Seyyed Mahdavi, S. (2018). Optimal design of hybrid energy system based on persuasive policies for renewable resources in Iran (case study: University of Bojnord). *Journal of Renewable and Sustainable Energy*, 10(4), 045906. <https://doi.org/10.1063/1.5031079>
- Saini, V., & Sangwan, S. (2018, January 18). Awareness on Gender Empowerment and Beti Bachao Beti Padhao Through Intervention. Retrieved from https://papers.ssrn.com/sol3/papers.cfm?abstract_id=3116715
- Sandwell, P., Chambon, C., Saraogi, A., Chabenat, A., Mazur, M., Ekins-Daukes, N., & Nelson, J. (2016). Analysis of energy access and impact of modern energy sources in unelectrified villages in Uttar Pradesh. *Energy for Sustainable Development*, 35, 67–79. <https://doi.org/10.1016/J.ESD.2016.09.002>
- Sengupta, M., Habte, A., Kurtz, S., Dobos, A., Wilbert, S., Lorenz, E., ... Perez, R. (2015). *Best Practices Handbook for the Collection and Use of Solar Resource Data for Solar Energy Applications*. Retrieved from www.nrel.gov/publications.
- Sharma, A., & Bairwa, B. L. (2018). An assessment of facilities available to children with special needs (cwsn) in government schools under sarva shiksha abhiyan. *International Journal of Social and Allied Research (IJSAR)*, 6(2), 43–46. Retrieved from <http://journals.foundationspeak.com/index.php/ijisar/article/view/502>
- Sharma, K. (2019). Hunger In Jharkhand: Dimensions Of Poverty And Food Security In Palamu District. *South Asia Research*, 39(1), 43–60. <https://doi.org/10.1177/0262728018816407>
- Shiroudi, A., Rashidi, R., Gharehpetian, G. B., Mousavifar, S. A., & Akbari Foroud, A. (2012). Case study: Simulation and optimization of photovoltaic-wind-battery hybrid energy system in Taleghan-Iran using homer software. *Journal of*

- Renewable and Sustainable Energy*, 4(5), 053111. <https://doi.org/10.1063/1.4754440>
- Taseska-Gjorgievska, V., Dedinec, A., Markovska, N., Kanevce, G., Goldstein, G., & Pye, S. (2013). Assessment of the impact of renewable energy and energy efficiency policies on the Macedonian energy sector development. *Journal of Renewable and Sustainable Energy*, 5(4), 041814. <https://doi.org/10.1063/1.4813401>
- Tijani, H. O., Wei Tan, C., & Bashir, N. (2014). Techno-economic analysis of hybrid photovoltaic/diesel/battery off-grid system in northern Nigeria. *Journal of Renewable and Sustainable Energy*, 6(3), 033103. <https://doi.org/10.1063/1.4873122>
- van Gevelt, T., Canales Holzeis, C., Fennell, S., Heap, B., Holmes, J., Hurley Depret, M., ... Safdar, M. T. (2018). Achieving universal energy access and rural development through smart villages. *Energy for Sustainable Development*, 43, 139–142. <https://doi.org/10.1016/J.ESD.2018.01.005>
- Verma, R., Dhaka, R., & Agrawal, G. (2018). Beti bachao, beti padhao programme: a right initiative to save the girl child. *International Journal Of Community Medicine And Public Health*, 5(6), 2153. <https://doi.org/10.18203/2394-6040.ijcmph20182139>
- Walia, H. S. (2018). The Naxal Quagmire in Bihar & Jharkhand – Genesis and Sustenance. *Learning community: an international journal of education and social development*, 9(1). <https://doi.org/10.30954/2231-458X.01.2018.7>
- WEO 2018. (n.d.). Retrieved February 1, 2019, from <https://www.iea.org/weo2018/>
- World Bank, & Bank, W. (2008). *of Rural Electrification: A Reassessment of the Costs and Benefits*. *International Finance*. <https://doi.org/978-0-8213-7368-2>
- Yadav, S. K., Sharma, R. S., & Birua, M. (2018). Sarva Shiksha Abhiyan: Achievements, Problems and Future Prospects: A Comparative Analysis of Some Indian States. In *Reflecting on India's Development* (pp. 175–201). Singapore: Springer Singapore. https://doi.org/10.1007/978-981-13-1414-8_9



© 2019. This article is an open access article distributed under the terms and conditions of the Creative Commons Attribution (CC BY) license (<http://creativecommons.org/licenses/by/4.0/>).